



GOVERNMENT OF KARNATAKA

Office of the District Fire Officer
Karnataka State Fire Service
Fire Station
BAGALKOT-587 102

C.NO/881/ADV/DFO/BAGALKOT/2022

Date: 20/12/2022

To,
Principal
Dhapalapur Vidya Vihar
School, Belagali
District. Bagalkot.

Sir,

Sub : Issue of '**Fire safety recommendation/Advice**' to Dhapalapur Vidya Vihar
School, Sy No 82/B, At : Ranna-Belagali, Tq : Mudhol, District : Bagalkot

Ref: 1) Applicant request letter Dated 15/12/2022.
2) No.GBC(2)044/2020-21 Dated 18/06/2022 S.O No.156-B.

**_*_*_*_*_*_

With reference to the subject above cited, the premises of **Dhapalapur Vidya Vihar School building consisting with Ground floor only situated at Sy No 82/B, Ranna-Belagali, Taluk Mudhol, & District Bagalkot.** was inspected by me on 17/12/2022 and submitted his report with respect to Fire prevention, Fire fighting and Evacuation measures to be complied in the above premises and has submitted the details as under.

ANNEXURE-II

For Educational Building of Ground floor only (Group B)

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings sub division B1 & B2.

Details of Fire prevention, Fire Fighting and Evacuation measure to be furnished for issuing of advise/compliance Certificate for school building comprising Only Ground Floor.

Part-A: General building requirements :-

S.No	Details	:	Observation
01	Name and Address of the Applicant.	:	Principal Dhapalapur Vidya Vihar School, Belagali District. Bagalkot.
02	Name and Address of the premises.	:	Om Sai Education Society ® Dhapalapur Vidya Vihar School Sy No : 82/B At : Ranna-Belagali Taluk -Mudhol & District. Bagalkot.
03	Name and address of the Building owner	:	Smt Veena R Dhapalapur Shri Vivek R Dhapalapur Smt Nivedita R Dhapalapur At : Belagali Road Tq : Mudhol
04	Number of buildings	:	01 Building
05	Occupancy of Ground floors	:	Class Room-14, Meeting Room, Staff room, Chairman office, Principal room, Office




			Room.
06	Height of the building	:	03.95 Mtrs
07	Site area	:	7288.40 Sq Mtrs
08	Built-up area of Ground floor:-	:	1514.13 Sq Mtrs
09.	Surrounding properties:-		
	East	:	Road (Mahalingpur to Belagali)
	West	:	RS No 82/1
	North	:	Garden
	South	:	RS No 82/4
10.	<u>Set-back area available around the building :-</u>		
	East	:	07.50 Mtr
	West	:	28.65 Mtr
	North	:	06.00 Mtr
	South	:	04.00 Mtr
	Allowed setbacks (open space) should be maintained free from further obstruction / construction		


Note : Recommended to provide and maintain setbacks as per Local ZR.

B. On inspection of this School/College Premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The premise is abutting by 12.00 mtrs. Wide hard surfaced road located on Eastern side.	Adequate
02.	No. of entrances	One entrance with 04.00 mtr width Open area. & Exit with ----- width	Required One more exit for the premises
03.	Portable extinguisher	Not provided	A. One CO2 type fire extinguisher, of 4.5 kgs. capacity should be provided near each electrical panel board & electrical room. B. One mechanical foam extinguisher of 9 ltrs. capacity & One ABC type extinguisher of 6 kgs. capacity should be provided near diesel generator. C. One DCP type fire extinguisher of 04 kgs capacity should be provided

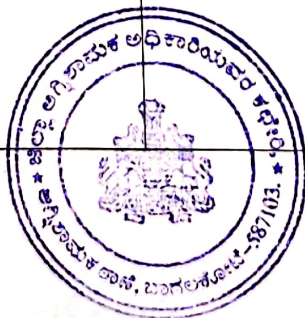

			<p>in the Kitchen if provided for the purpose of Mid Day Meal.</p> <p>D.One ABC type fire extinguisher of 06 kgs capacity should be located as to be available within 15 mtrs. radius.</p> <p>E. All Extinguisher suggested above should be with BIS markings and should be located at an easily accessible position without obstructing the normal passage and maintained periodically.</p>
04.	Escape routes	Not Marked	Recommended to Provide Direction in which the inmates should have to move in the event of any emergency have to be indicated in the corridor/passage as a guide during evacuation staff. These marking should be in luminous paint
05.	Fire order (Fire Safety Plan)	Not Provided	A notice board has been displayed the Action to be taken by the Students/Staffs in Case of an emergency with Telephone Numbers of Mudhol Fire Station i. e. 08350-283101, 112 & 101 and telephone numbers of nearest Ambulance Service Has to displayed.
06.	No smoking board	Not displayed	As per Sec-4 of COPTA a board with words NO SMOKING AREA shall be written in English & Kannada both language shall be prominently displayed at inside the entry/exit of the each floor.
07.	Fire Siren	Not Installed	A Fire Siren shall be installed in the premises to inform the inmates in case of a fire emergency and evacuate the area.

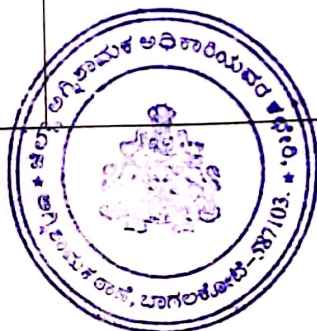

08.	Nominate one Fire Nodal Officer	-	A Fire Nodal officer shall be nominated either from teaching or non teaching staff
09.	Training in Fire fighting	Not imparted	At-least 40% of teaching or non teaching Should be got trained in basic fire fighting at R.A.Mundkur fire & Emergency Services Academy, Bannerughatta road, Bangalore or Regional training centre within 3 months or at an early date. And shall be submitted to this office.
10.	Fire precautionary measures:- <ol style="list-style-type: none"> Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises. Accumulation of combustible waste in and around the premises should be avoided. The exit ways shall be always kept clear without any obstruction. Liquefied petroleum gas should not be stored in the building. The doors shall not be kept locked/latched during working hours and shall be free from obstruction. During the class hours the class room doors shall not be locked from inside to outside. As per Hon'ble supreme court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department. 		


Under the above circumstance the Karnataka Fire And Emergency Service Department is issuing **Fire Safety Recommendation** to **Dhapalapur Vidya Vihar School building** consisting with **Ground floor only** situated at Sy No 82/B, Ranna-Belagali, Taluk - Mudhol, & District-Bagalkot. Subject to condition and compliance of the above recommendations in column 4 of serial B within 03 months compliance to the undersigned.

♣ All requirements recommended above are as per National Building Code-2016 Part-4 clause 3.1.4 of Fire and Life safety will have to be complied with mandatorily.

From the above details it is clear that the 'Management' of the above Educational building have been recommended to provide fire precautionary measures as per **National Building Code 2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2**. After full-filling the above recommendations, a Certificate should be obtained by this office. *If at any time any of the conditions are found not complied with, this Certificate shall stand withdrawn/cancelled.*

The **Fire Safety Recommendation** is valid for a period of one year from the date of issue and it is renewable.

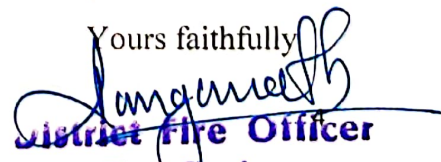

Yours faithfully

District Fire Officer
Fire Station
BAGALKOT-587 102

FIRE SAFETY CERTIFICATE

Office of the District Fire Officer
Karnataka State Fire Service
Fire Station
BAGALKOT-587 102

No : 881/DFO/BAGALKOT/2022

Date: 20/12/2022

Certified that the Dhapalapur Vidya Vihar School, (name of the building or premises) at Sy No : 82/B, Ranna-Belagali, Mudhol Tq & Dist, Karnataka State (address) comprised of Ground Floor Only Owned / Occupied by Dhapalapur Vidya Vihar School, Ranna-Belagali, Mudhol Tq & Dist, Karnataka State, Om Sai Education Society ® (name of the Institution) have complied with the fire prevention and safety requirements in accordance with rule of State/ UT Fire Service Rule, and verified by the officers concerned of Fire Service on 17/12/2022 (date of inspection) in the presence of The Principal Dhapalapur Vidya Vihar School Ranna-Belagali (name and addresses of the secretary or his representative) and that the building / premises is fit for occupancy class LKG to X with effect from 20/12/2022 for a period of One year in accordance with rule and subject to compliance of the conditions.

This Certificate issued on the basis of the District Fire Officer Bagalkot vide Advise
 C.No/881/ADV/DFO/BAGALKOT/2022. Dated : 20/12/2022.

- Strike out whichever is not applicable

Signature with seal :

Name :

Designation

[Signature]
District Fire Officer
Fire Station
BAGALKOT-587 102

To,

PrincipalDhapalapur Vidya Vihar SchoolRanna-BelagaliTq Mudhol & Dist : Bagalkot

(Name & Address of the Institution)

ENDORSEMENT

The No Objection Certificate issued by Service stand cancelled & Annulled Due to _____

(Reason to be recorded)

(Name and Designation of the Authorized)